


Certificate of Analysis

Produced: Feb 16, 2026

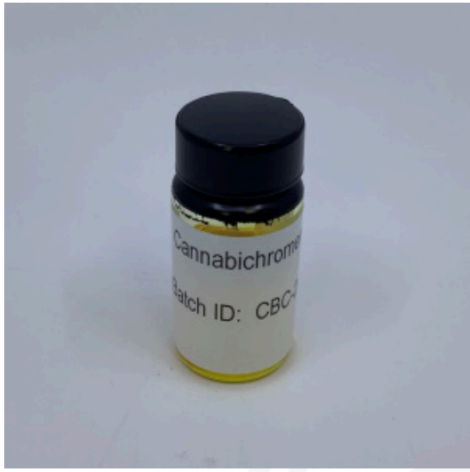

Batch No.
Matrix: Distillate
Submatrix: Non-inhalable Concentrate
Sample ID
Collected on: Feb 12, 2026
Received on: Feb 12, 2026
Batch Size:
Sample Size:

Batch Result: Pass

Potency	Tested	Microbial	Pass
Solvents	Pass	Mycotoxins	Pass
Metals	Pass	Pesticides	Pass

Cannabinoid Overview

Δ⁹-THC:	0.000 %
CBD:	0.000 %
Total Cannabinoids:	96.8 %
Sum of Cannabinoids:	96.8 %

POT-INST-005, POT-PREP-001: POT-INST-005, POT-PREP-001: Expanded Potency • Feb 12, 2026

Analyte	Amt (%)	Amt (mg/g)	LOD/LOQ (mg/g)	Pass/Fail	Analyte	Amt (%)	Amt (mg/g)	LOD/LOQ (mg/g)	Pass/Fail
CBC	96.4	964	0.340/1.02	N/A	CBN	ND	ND	0.117/0.515	N/A
CBCA	ND	ND	0.477/1.43	N/A	CBNA	ND	ND	0.175/0.525	N/A
CBCV	ND	ND	0.147/0.515	N/A	CBT	0.396	3.96	0.147/0.515	N/A
CBD	ND	ND	0.104/0.515	N/A	Δ ⁸ -THC	ND	ND	0.0833/0.515	N/A
CBDA	ND	ND	0.248/0.745	N/A	Δ ⁹ -THC	ND	ND	0.137/0.515	N/A
CBDV	ND	ND	0.0824/0.515	N/A	THCA	ND	ND	0.189/0.567	N/A
CBDVA	ND	ND	0.270/0.809	N/A	THCV	ND	ND	0.0636/0.515	N/A
CBG	ND	ND	0.117/0.515	N/A	THCVA	ND	ND	0.205/0.617	N/A
CBGA	ND	ND	0.183/0.550	N/A	Total THC**	ND	ND		N/A
CBL	ND	ND	0.0810/0.515	N/A	Total CBD**	ND	ND		N/A
CBLA	ND	ND	1.12/3.37	N/A	Total Cannabinoids**	96.8	968		N/A

** Total Cannabinoids = Neutral Cannabinoids + (Acidic Cannabinoids * 0.877)

** Total THC = Delta-8-THC + (Delta-8-THCA x 0.877) + Delta-9-THC + (THCA x 0.877)

** Total CBD = CBD + (CBDA x 0.877)

NR= Not Reported, ND= Not Detected, *Reported by Dry Mass*; *analytical instrumentation used Cannabinoids: UHPLC-DAD, Moisture: Mass by Drying, Water Activity: Water Activity Meter, Foreign: Microscope*

*Density tested at a temperature range between 19-24 °C, *Water Activity tested at a humidity range between 0-90% Relative Humidity. All OA samples are sampled by the client, All California State Compliant samples sampled using SAMPL-SOP-001.

RS-INST-003, RS-PREP-001: RS-INST-003, RS-PREP-001: Residual Solvents by GC-MS • Feb 12, 2026

Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail	Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail
1,2-Dichloroethane	1	ND	0.165/0.504	Pass	Hexane	290	ND	0.0653/0.278	Pass
Acetone	5000	71.2	16.9/50.7	Pass	Isopropyl alcohol	5000	ND	1.27/3.80	Pass
Acetonitrile	410	ND	0.119/0.355	Pass	Methanol	3000	ND	2.94/8.83	Pass
Benzene	1	ND	0.0208/0.0633	Pass	Methylene chloride	1	ND	0.126/0.722	Pass
Butane	5000	ND	0.961/4.80	Pass	Pentane	5000	ND	0.952/4.23	Pass
Chloroform	1	ND	0.0356/0.107	Pass	Propane	5000	ND	4.39/13.2	Pass
Ethanol	5000	ND	2.59/7.76	Pass	Toluene	890	72.4	0.0871/0.855	Pass
Ethyl acetate	5000	< LOQ	0.310/2.27	Pass	Trichloroethylene	1	ND	0.0178/0.144	Pass
Ethylene oxide	1	ND	0.151/0.573	Pass	o-Xylene		ND	0.0997/0.848	N/A
Ethyl ether	5000	ND	1.17/3.51	Pass	p- and m-Xylene		ND	0.114/1.70	N/A
Heptane	5000	ND	0.680/2.83	Pass	Total xylenes	2170	ND	0.0998/0.849	Pass

HM-INST-003, HM-PREP-001: HM-INST-003, HM-PREP-001: Heavy Metals Testing by ICP-MS • Feb 13, 2026

Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail	Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail
Arsenic	1.5	ND	0.00300/0.00900	Pass	Lead	0.5	ND	0.00100/0.00400	Pass
Cadmium	0.5	ND	0.00100/0.00200	Pass	Mercury	3	ND	0.00500/0.0140	Pass

MICRO-008, MICRO-INST-001, MICRO-PREP-001: MICRO-008, MICRO-INST-001, MICRO-PREP-001: PCR-Microbial (noninhalable) • Feb 16, 2026


Analyte	Limit	Amt	Pass/Fail	Analyte	Limit	Amt	Pass/Fail
Salmonella spp.	Any amt in 1 gram	ND	Pass	Shiga toxin-producing E. coli	Any amt in 1 gram	ND	Pass

PESTMYCO-LC-INST-004, PESTMYCO-LC-PREP-001: PESTMYCO-LC-INST-004, PESTMYCO-LC-PREP-001: Mycotoxin Analysis by LC-MS/MS • Feb 16, 2026

Analyte	Limit (µg/kg)	Amt (µg/kg)	LOD/LOQ (µg/kg)	Pass/Fail	Analyte	Limit (µg/kg)	Amt (µg/kg)	LOD/LOQ (µg/kg)	Pass/Fail
Aflatoxin B1		ND	2.96/8.98	N/A	Aflatoxin G2		ND	2.07/6.26	N/A
Aflatoxin B2		ND	3.36/10.2	N/A	Aflatoxins	20	ND		Pass
Aflatoxin G1		ND	1.73/5.25	N/A	Ochratoxin A	20	ND	4.41/13.4	Pass


PEST-GC-INST-003, PEST-GC-PREP-001: PEST-GC-INST-003, PEST-GC-PREP-001: Pesticide Analysis by GC-MS/MS • Feb 16, 2026

Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail	Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail
Captan	5	ND	0.120/0.358	Pass	Cypermethrin	1	ND	0.0602/0.181	Pass
Chlordane	Any amt	ND	0.0249/0.0747	Pass	Methyl parathion	Any amt	ND	0.00811/0.0243	Pass
Chlorfenapyr	Any amt	ND	0.0251/0.0753	Pass	Pentachloronitrobenzene	0.2	ND	0.0182/0.0545	Pass
Cyfluthrin	1	ND	0.0186/0.0558	Pass					

PESTMYCO-LC-INST-004, PESTMYCO-LC-PREP-001: PESTMYCO-LC-INST-004, PESTMYCO-LC-PREP-001: Pesticide Analysis by LC-MS/MS • Feb 16, 2026

Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail	Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail
Abamectin	0.3	ND	0.0500/0.100	Pass	Imazalil	Any amt	ND	0.00898/0.0300	Pass
Acephate	5	ND	0.00743/0.0300	Pass	Imidacloprid	3	ND	0.0109/0.0331	Pass
Acequinocyl	4	ND	0.0150/0.0456	Pass	Kresoxim-methyl	1	ND	0.00708/0.0300	Pass
Acetamiprid	5	ND	0.00496/0.0300	Pass	Malathion	5	ND	0.00313/0.0300	Pass
Aldicarb	Any amt	ND	0.00838/0.0300	Pass	Metalaxyl	15	ND	0.00467/0.0300	Pass
Azoxystrobin	40	ND	0.00530/0.0300	Pass	Methiocarb	Any amt	ND	0.00245/0.0300	Pass
Bifenazate	5	ND	0.00706/0.0300	Pass	Methomyl	0.1	ND	0.00879/0.0300	Pass
Bifenthrin	0.5	ND	0.00439/0.0300	Pass	Mevinphos	Any amt	ND	0.00772/0.0300	Pass
Boscalid	10	ND	0.00809/0.0300	Pass	Myclobutanil	9	ND	0.00707/0.0300	Pass
Carbaryl	0.5	ND	0.00604/0.0300	Pass	Naled	0.5	ND	0.00849/0.0300	Pass
Carbofuran	Any amt	ND	0.00538/0.0300	Pass	Oxamyl	0.2	ND	0.00746/0.0300	Pass
Chlorantraniliprole	40	ND	0.00883/0.0300	Pass	Paclobutrazol	Any amt	ND	0.00851/0.0300	Pass
Chlorpyrifos	Any amt	ND	0.0152/0.0460	Pass	Permethrin	20	ND	0.00190/0.0300	Pass
Clofentezine	0.5	ND	0.00206/0.0300	Pass	Phosmet	0.2	ND	0.00511/0.0300	Pass
Coumaphos	Any amt	ND	0.00393/0.0300	Pass	Piperonylbutoxide	8	ND	0.00267/0.0300	Pass
Daminozide	Any amt	ND	0.0176/0.0534	Pass	Prallethrin	0.4	ND	0.0235/0.0711	Pass
Diazinon	0.2	ND	0.00475/0.0300	Pass	Propiconazole	20	ND	0.00909/0.0300	Pass
Dichlorvos	Any amt	ND	0.0182/0.0550	Pass	Propoxur	Any amt	ND	0.00780/0.0300	Pass
Dimethoate	Any amt	ND	0.00592/0.0300	Pass	Pyrethrins	1	ND	0.00278/0.0300	Pass
Dimethomorph	20	ND	0.00454/0.0300	Pass	Pyridaben	3	ND	0.00231/0.0300	Pass
Ethoprophos	Any amt	ND	0.00610/0.0300	Pass	Spinetoram	3	ND	0.00119/0.0300	Pass
Etofenprox	Any amt	ND	0.00437/0.0300	Pass	Spinosad	3	ND	0.000830/0.0300	Pass
Etoxazole	1.5	ND	0.00365/0.0300	Pass	Spiromesifen	12	ND	0.00894/0.0300	Pass
Fenhexamid	10	ND	0.0113/0.0342	Pass	Spirotetramat	13	ND	0.00808/0.0300	Pass
Fenoxycarb	Any amt	ND	0.00415/0.0300	Pass	Spiroxamine	Any amt	ND	0.00555/0.0300	Pass
Fenpyroximate	2	ND	0.00396/0.0300	Pass	Tebuconazole	2	ND	0.00605/0.0300	Pass
Fipronil	Any amt	ND	0.0165/0.0500	Pass	Thiacloprid	Any amt	ND	0.00506/0.0300	Pass
Fonicamid	2	ND	0.0115/0.0350	Pass	Thiamethoxam	4.5	ND	0.00760/0.0300	Pass
Fludioxonil	30	ND	0.0119/0.0362	Pass	Trifloxystrobin	30	ND	0.00293/0.0300	Pass
Hexythiazox	2	ND	0.00124/0.0300	Pass					

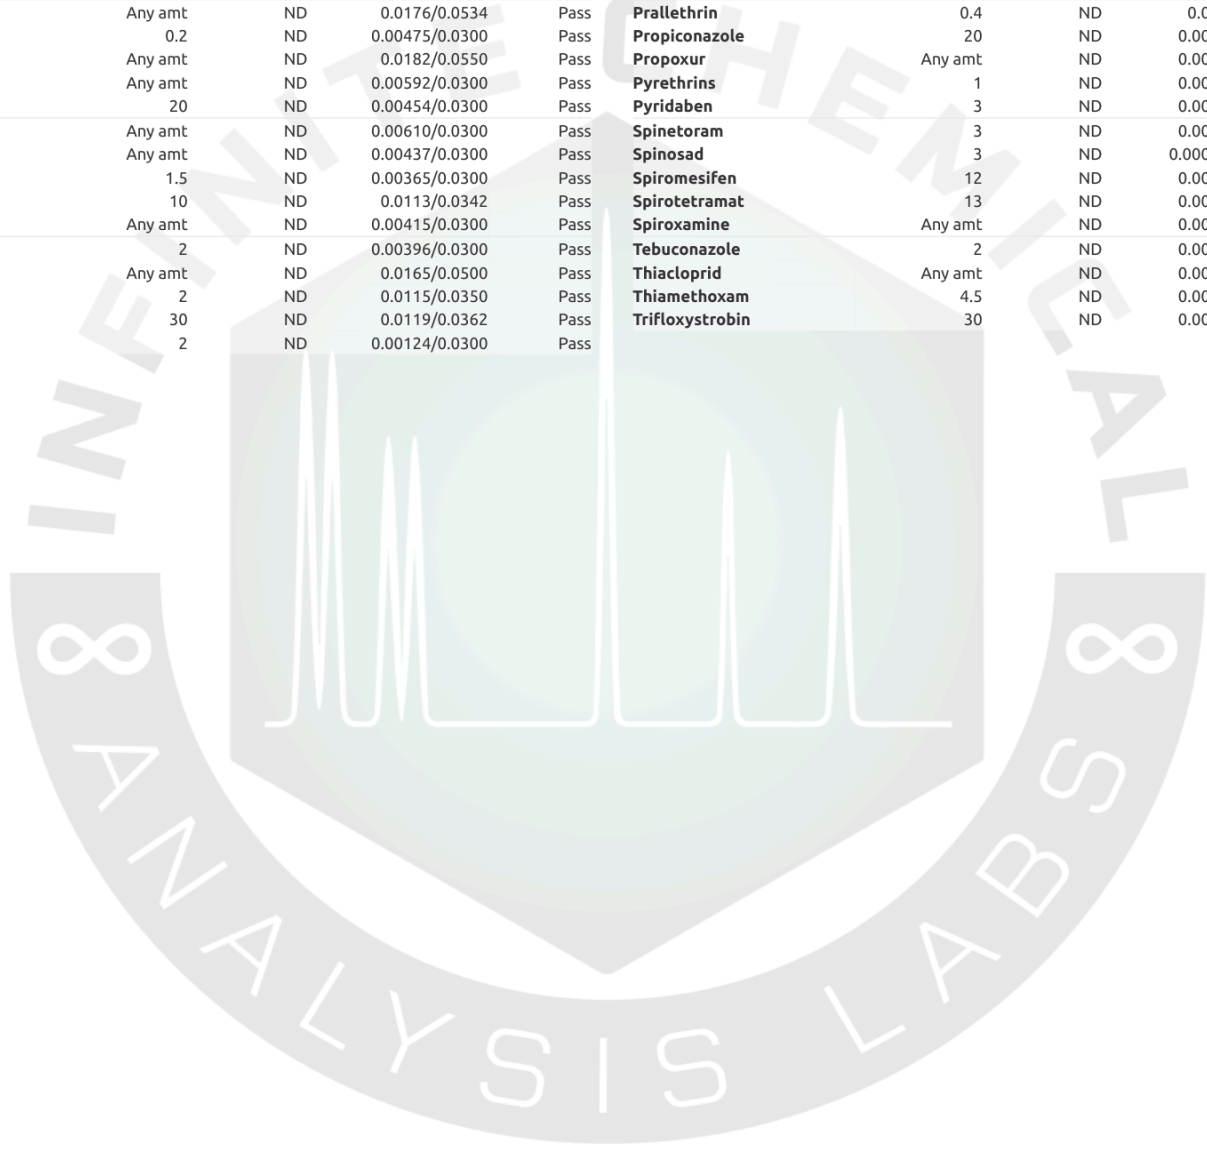

DM

Erik Paulson